


Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-20 00:00 - 2019-05-26 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_1
Location Fændediget 10
Sensor type C22
Serial no. 101687
Master(s) serial no. 101687
Latest calibration 2018-10-09
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 2 min
Frequency weighting OFF

Max V: 0.80 mm/s, L: 0.88 mm/s, T: 0.60 mm/s

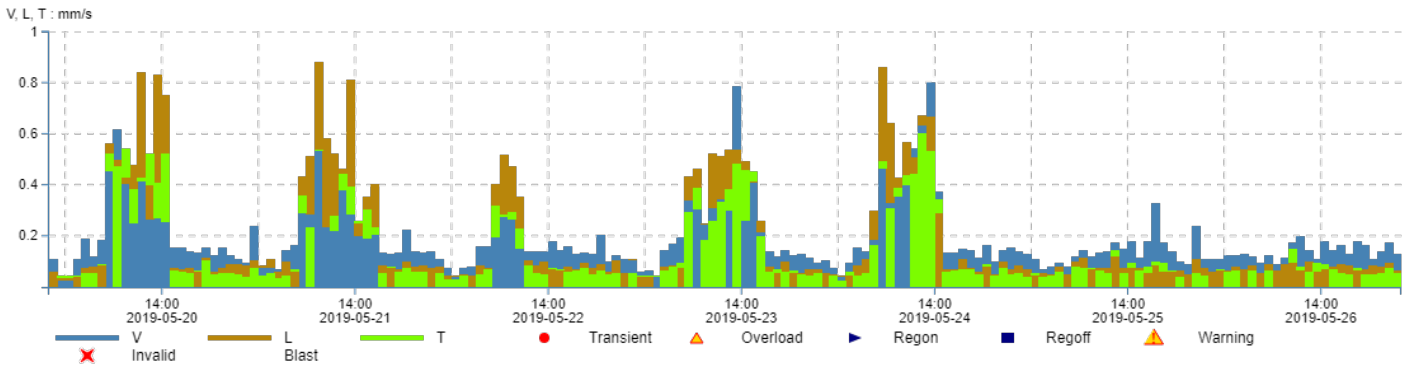

X-span 2019-05-20 00:00:00 - 2019-05-26 23:59:00

Y-span V, L, T : mm/s: 0.0 - 1.0


| | V | L | T |
|-------------|------------|------------|------------|
| Max | 0.80 mm/s | 0.88 mm/s | 0.60 mm/s |
| Date | 2019-05-24 | 2019-05-21 | 2019-05-24 |
| Time | 14:00:00 | 10:00:00 | 13:00:00 |

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-20 00:00 - 2019-05-26 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_2
Location Fændediget 12
Sensor type C22
Serial no. 101655
Master(s) serial no. 101655
Latest calibration 2018-10-09
Standard DIN4150-3 Anlag 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 5 sec
Frequency weighting OFF

Max V: 2.45 mm/s, L: 1.47 mm/s, T: 1.55 mm/s

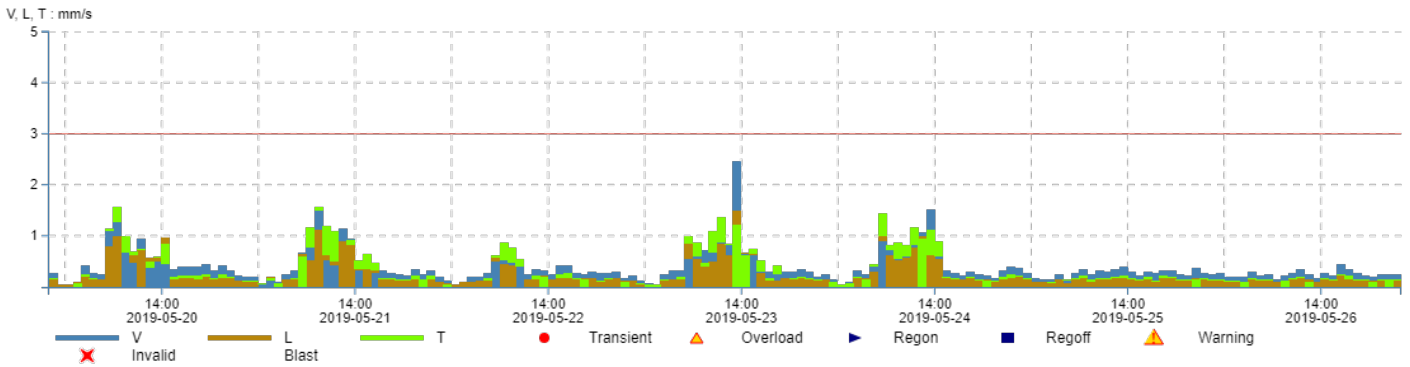

X-span 2019-05-20 00:00:00 - 2019-05-26 23:59:00

Y-span V, L, T : mm/s: 0.0 - 5.0


| | V | L | T |
|-------------|------------|------------|------------|
| Max | 2.45 mm/s | 1.47 mm/s | 1.55 mm/s |
| Date | 2019-05-23 | 2019-05-23 | 2019-05-20 |
| Time | 14:00:00 | 14:00:00 | 09:00:00 |

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-20 00:00 - 2019-05-26 23:59 (Europe/Copenhagen)

NB!
 Chart data is aggregated by 1 h

Measure point MP_3
Location Åvænget 21
Sensor type C22
Serial no. 101681
Master(s) serial no. 101681
Latest calibration 2018-10-08
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 2 min
Frequency weighting OFF

Max V: 0.48 mm/s, L: 0.35 mm/s, T: 0.28 mm/s

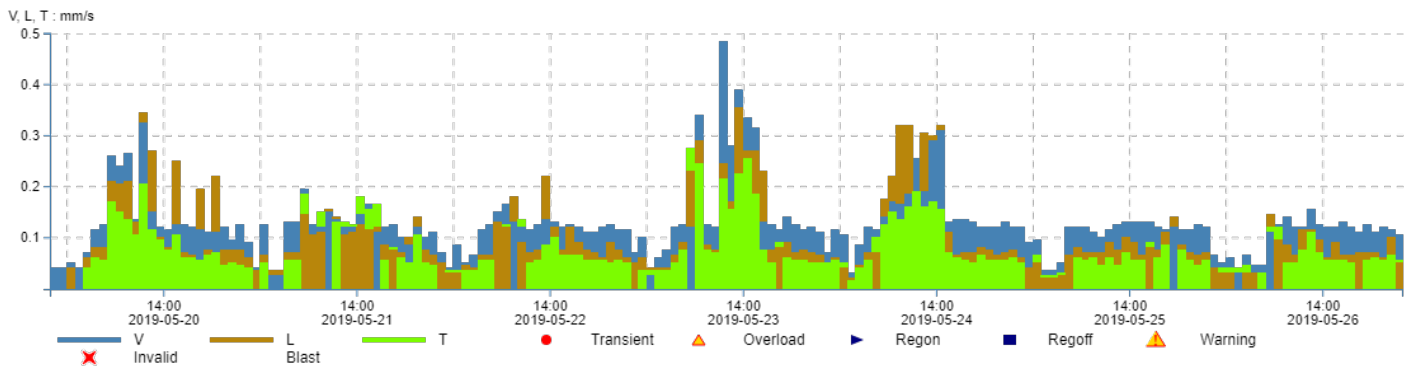

X-span 2019-05-20 00:00:00 - 2019-05-26 23:59:00

Y-span V, L, T : mm/s: 0.0 - 0.50


| | V | L | T |
|-------------|------------|------------|------------|
| Max | 0.48 mm/s | 0.35 mm/s | 0.28 mm/s |
| Date | 2019-05-23 | 2019-05-23 | 2019-05-23 |
| Time | 12:00:00 | 14:00:00 | 08:00:00 |

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-20 00:00 - 2019-05-26 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_4
Location Tolbodvej 11
Sensor type C22
Serial no. 101683
Master(s) serial no. 101683
Latest calibration 2018-10-08
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 5 sec
Frequency weighting OFF

Max V: 1.21 mm/s, L: 1.0 mm/s, T: 0.44 mm/s

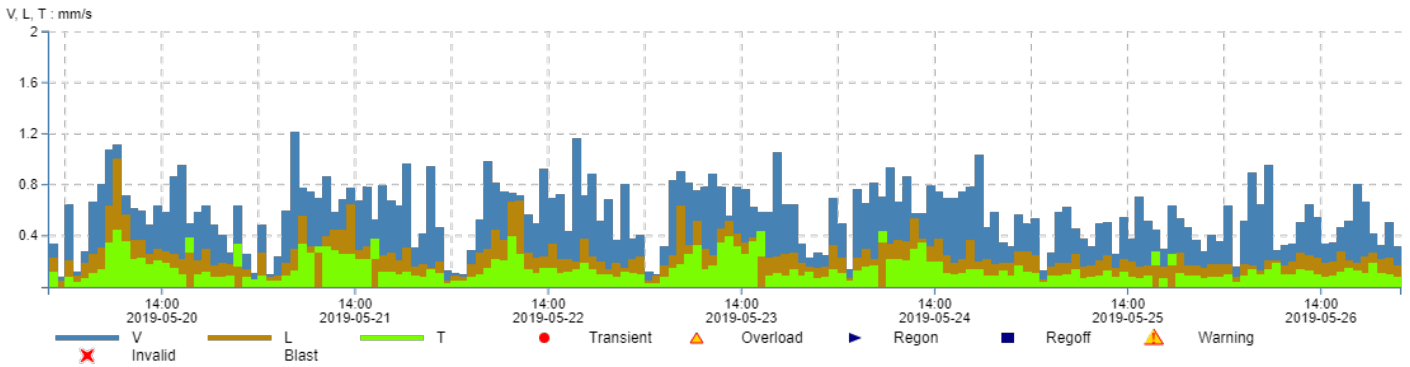

X-span 2019-05-20 00:00:00 - 2019-05-26 23:59:00

Y-span V, L, T : mm/s: 0.0 - 2.0


| | V | L | T |
|-------------|------------|------------|------------|
| Max | 1.21 mm/s | 1.0 mm/s | 0.44 mm/s |
| Date | 2019-05-21 | 2019-05-20 | 2019-05-20 |
| Time | 07:00:00 | 09:00:00 | 09:00:00 |

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-20 00:00 - 2019-05-26 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_5
Location Åvænget 29
Sensor type C22
Serial no. 101660
Master(s) serial no. 101660
Latest calibration 2018-10-09
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 2 min
Frequency weighting OFF

Max V: 0.28 mm/s, L: 0.23 mm/s, T: 0.47 mm/s

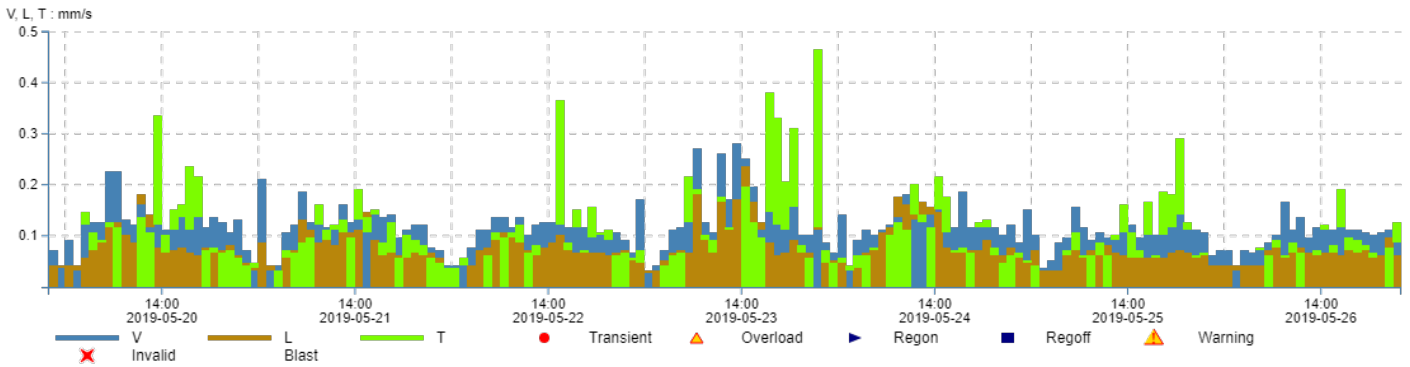

X-span 2019-05-20 00:00:00 - 2019-05-26 23:59:00

Y-span V, L, T : mm/s: 0.0 - 0.50


| | V | L | T |
|-------------|------------|------------|------------|
| Max | 0.28 mm/s | 0.23 mm/s | 0.47 mm/s |
| Date | 2019-05-23 | 2019-05-23 | 2019-05-24 |
| Time | 14:00:00 | 15:00:00 | 00:00:00 |

Project Ivar Huitfeldtsvej, 4600 Køge
Project maintainer Jesper Haugaard
Customer NCC
Customer contact Petra Ghanem (+4546790101)
Time frame 2019-05-20 00:00 - 2019-05-26 23:59 (Europe/Copenhagen)

NB!
Chart data is aggregated by 1 h

Measure point MP_6
Location Åvænget 25
Sensor type C22
Serial no. 101681
Master(s) serial no. 101681
Latest calibration 2018-10-08
Standard DIN4150-3 Anlage 25mm/s 1-315Hz
Unit mm/s
Quantity Velocity
Interval time 2 min
Frequency weighting OFF

Max V: 0.48 mm/s, L: 0.35 mm/s, T: 0.28 mm/s

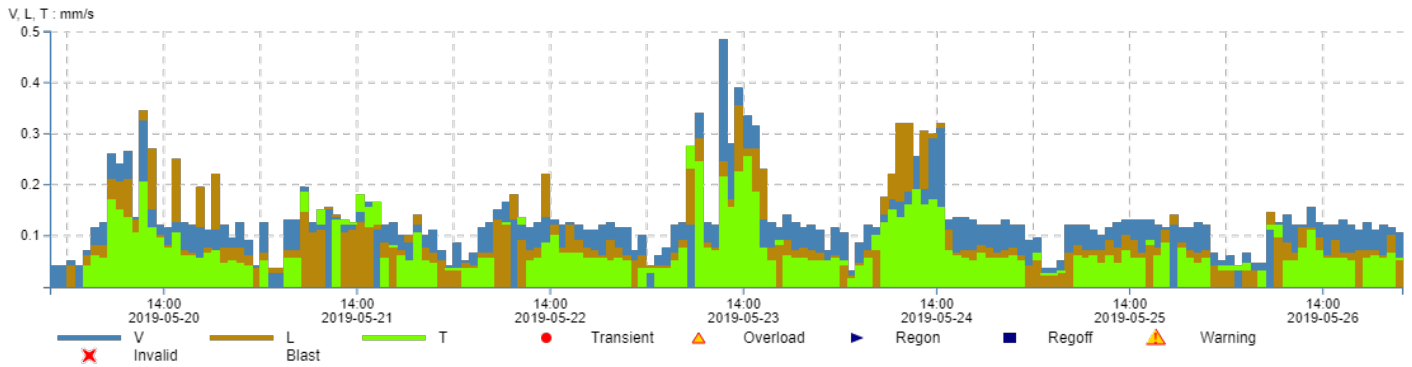

X-span 2019-05-20 00:00:00 - 2019-05-26 23:59:00

Y-span V, L, T : mm/s: 0.0 - 0.50

| | V | L | T |
|-------------|------------|------------|------------|
| Max | 0.48 mm/s | 0.35 mm/s | 0.28 mm/s |
| Date | 2019-05-23 | 2019-05-23 | 2019-05-23 |
| Time | 12:00:00 | 14:00:00 | 08:00:00 |